



Plan Review Building Electric
 App. By **JA GOMEZ**
 Date **05/03/2013**
 Note: This plan is invalid unless accompanied by a Go Solar permit card and Go Solar permit document. Plans must be on job before any inspection will be made.

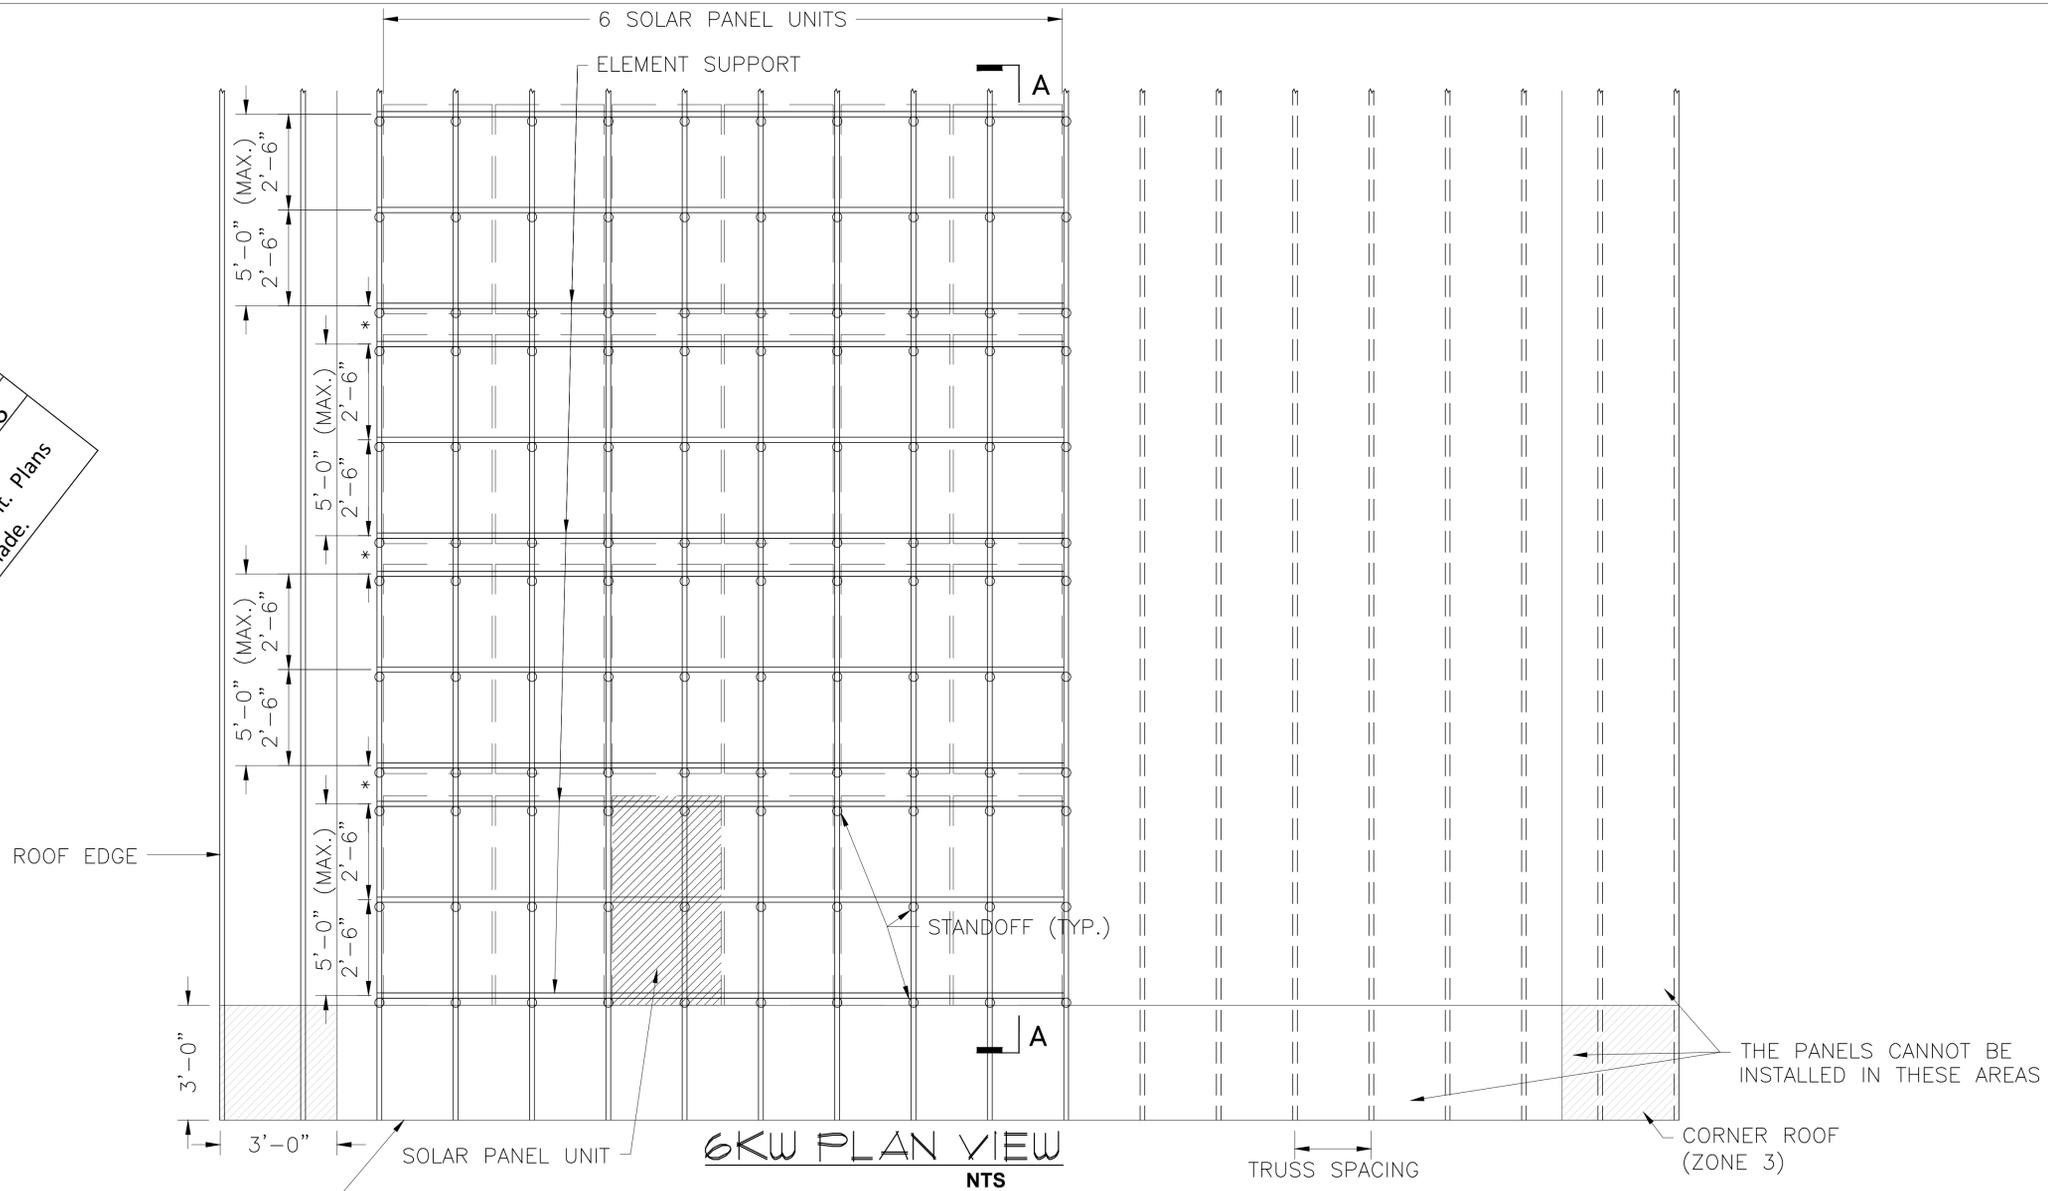

**LAYOUT FOR SOLAR PANELS ON ROOF ZONE 1 PER FBC 2010
 (LOCATION SHALL NOT BE WITHIN ZONES 2 & 3 AS SHOWN)**

ARRANGEMENT BASED ON A 39" x 65" SOLAR PANEL DIMENSIONS * CONFIRM FOR SITE CONDITIONS, SEPARATION BETWEEN PANELS 12" MINIMUM

- FSEC APPROVED PANELS (250 WATTS) TO COMPLY WITH U.L.1703
1. 1SOLTECH MODEL SPM-240G
 2. ASEC MODEL 250G6M6B
 3. LIGHTWAY SOLAR MODEL LW250(29)
 4. GREEN TRIPLEX MODEL PM250M00
 5. MONOX MODEL LG250S1C
- NOTE: LIST IS NOT INTENDED TO SHOW ALL CERTIFIED; EQUAL ALTERNATIVES MAY BE USED. SOLAR PANELS USERS ARE ENCOURAGED TO REVIEW MANUFACTURERS AND INSTALLERS DATA FROM FSEC LISTS.

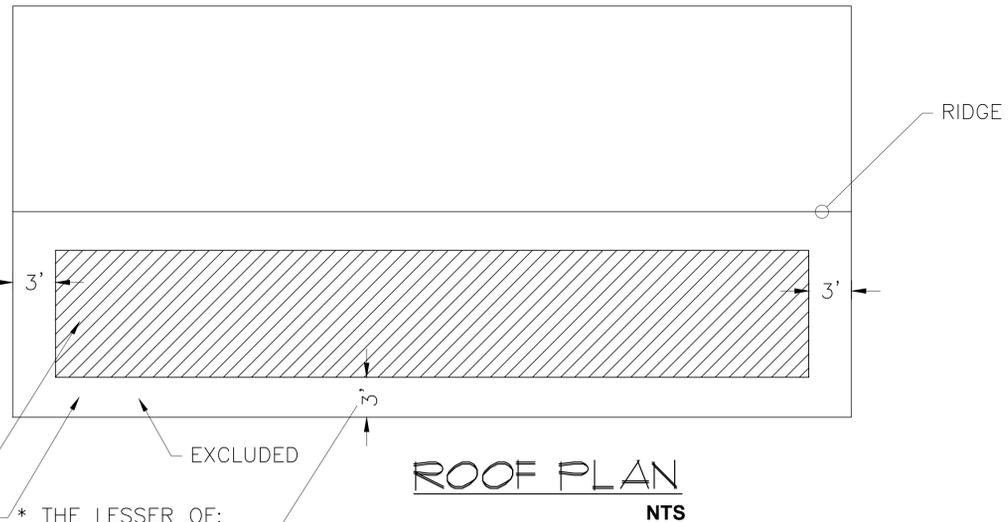


LEGEND:
 CAN BE INSTALLED
 CANNOT BE INSTALLED
 *

SOLAR PANELS CANNOT BE INSTALLED IN THIS AREA

* THE LESSER OF:
 10% OF BUILDING MIN. DIMENSION
 40% OF BUILDING HEIGHT
 BUT NO LESS THAN 4% OF BUILDING MIN. DIMENSION OR 3'

JUAN E. LAPICA, P.E.
 LICENSE NO. 34290
 STRUCTURAL ENGINEER

TYLIN INTERNATIONAL
 201 ALHAMBRA CIRCLE • SUITE 900
 CORAL GABLES, FLORIDA
 PHONE: (305) 567-1888 • FAX: (305) 567-1771
 E.B.# 00002017
 www.tylin.com
 04/16/2013



CARTAYA & ASSOCIATES ARCHITECTS P.A.

3077 E. COMMERCIAL BLVD. SUITE 201
 FT. LAUDERDALE, FLORIDA 33308
 771-2724 FAX 776-4280

BEAU
 AA C001988

PROJECT: **PHOTOVOLTAIC SYSTEM PROTOTYPE DESIGN
 GO SOLAR - BROWARD COUNTY
 ENVIRONMENTAL PLANNING AND GROWTH MANAG. DEPT.**


ALL DESIGN AND DETAILS ASSOCIATED WITH THIS DRAWING ARE FOR USE ON THE PROJECT AND IN CONNECTION WITH THE SPECIFIED PROJECT. THIS IS THE PROPERTY OF CARTAYA & ASSOCIATES ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT WRITTEN PERMISSION FROM THE ARCHITECT. THE ARCHITECT ASSUMES NO LIABILITY FOR ANY ERRORS OR OMISSIONS IN THIS DRAWING. THE ARCHITECT'S RESPONSIBILITY IS LIMITED TO THE DESIGN AND CONSTRUCTION OF THE PROJECT AS SHOWN ON THIS DRAWING.

TITLE: **6KW PLAN VIEW**

DATE: 04-16-2013
 DRAWN BY: YR
 CHECKED BY: JJ

JOB NO: **1236**

SHEET: **A-1**
 1 OF 7



CARTAYA & ASSOCIATES ARCHITECTS P.A.

3077 E. COMMERCIAL BLVD. SUITE 201 FT. LAUDERDALE, FLORIDA 33308 771-2724 FAX 776-4280

AA C001888
BEAU



PROJECT: PHOTOVOLTAIC SYSTEM PROTOTYPE DESIGN
GO SOLAR - BROWARD COUNTY
ENVIRONMENTAL PLANNING AND GROWTH MANAG. DEPT.
ALL DIMENSIONS AND DETAILS UNLESS INDICATED BY THIS DRAWING ARE FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. THIS IS THE PROPERTY OF CARTAYA & ASSOCIATES ARCHITECTS P.A. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT WRITTEN PERMISSION FROM CARTAYA & ASSOCIATES ARCHITECTS P.A. AND NOT BE USED FOR ANY OTHER PROJECTS WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. ANY VIOLATION OF THESE TERMS SHALL BE AT THE USER'S SOLE RISK AND WITHOUT LIABILITY TO THE ARCHITECT.

TITLE: 6KW SECTION

DATE: 04-16-2013
DRAWN BY: YR
CHECKED BY: JJ

JOB NO: 1236

SHEET: A-2
2 OF 7

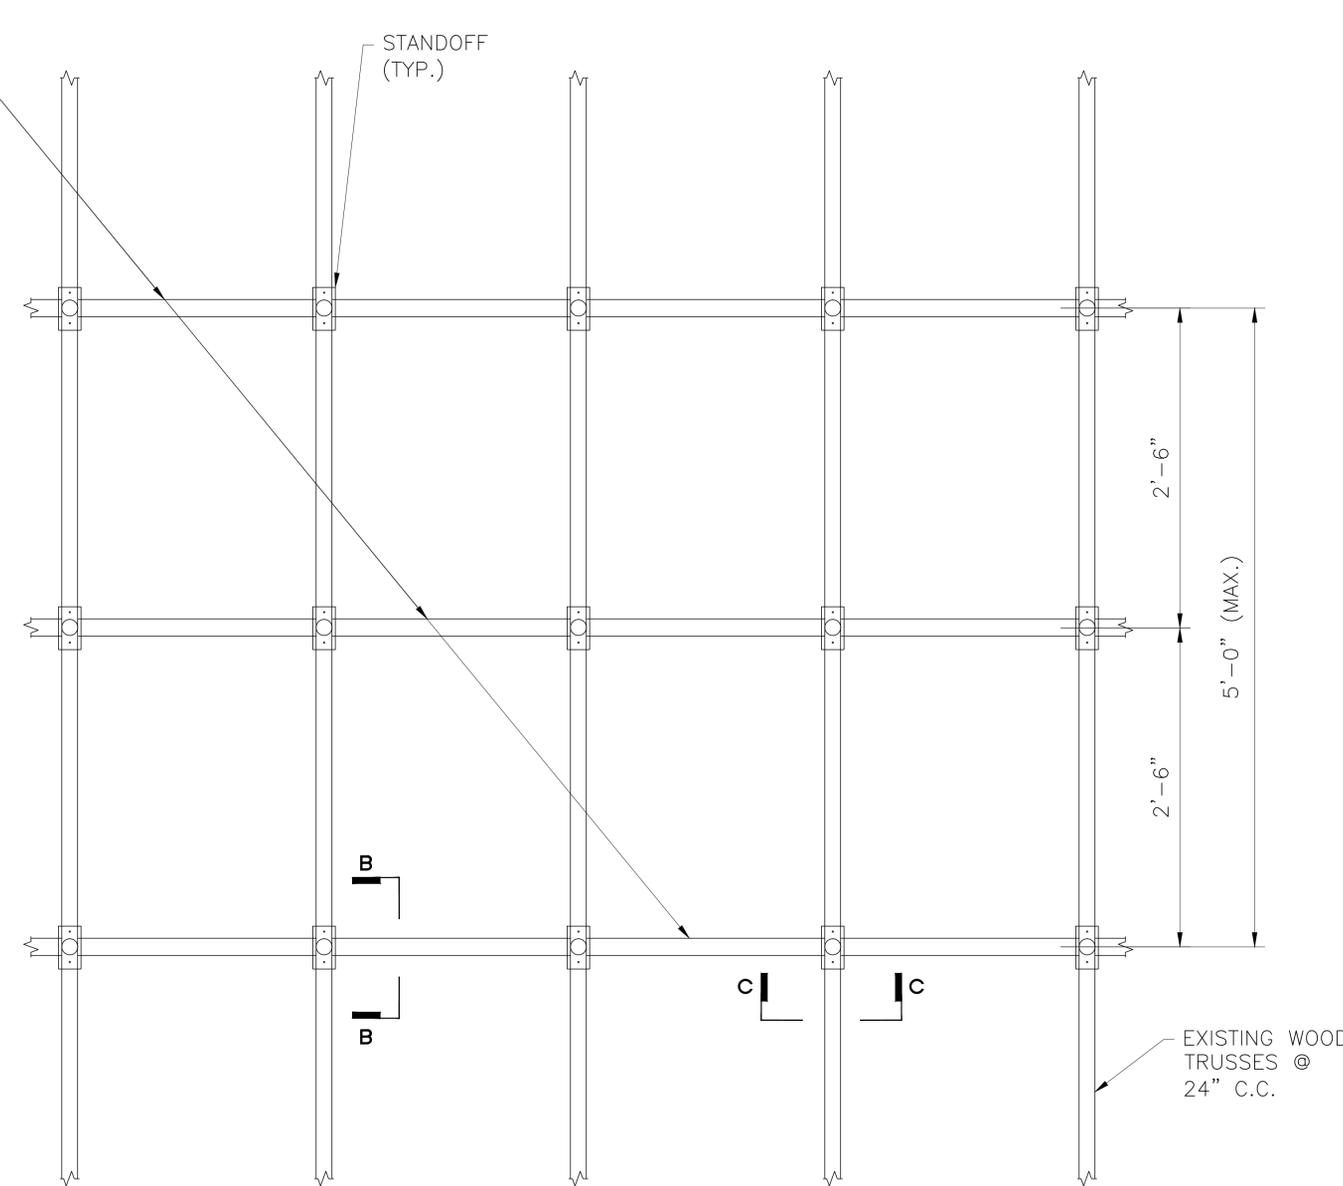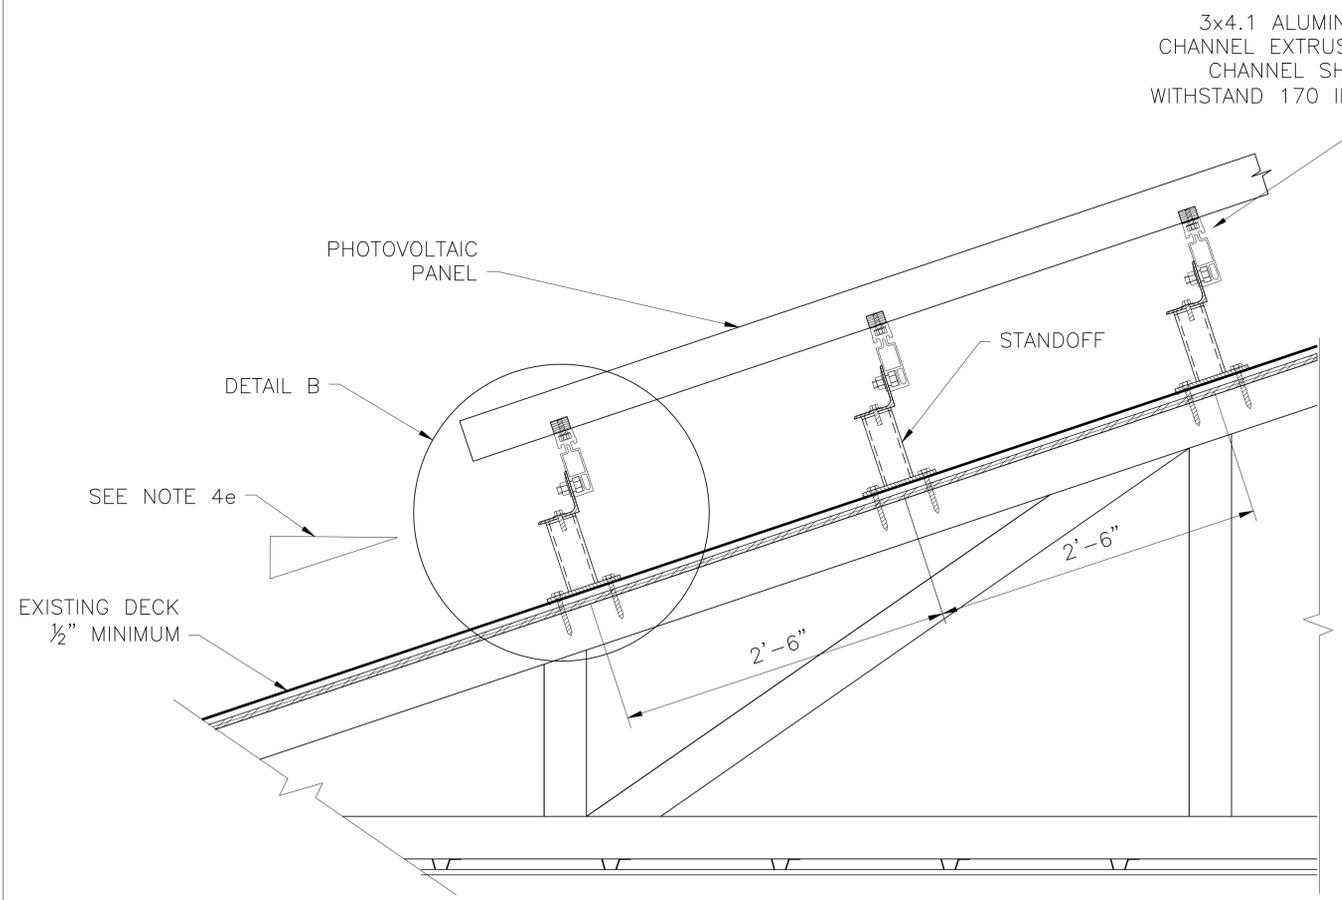

PARTIAL PLAN VIEW
SOLAR PANEL ATTACHMENT

A SECTION
SCALE: 1" = 1'-0"

Plan Review	App. By	Date
Building	J. AGOMEZ	05/03/2013
Electric	NA	05/03/2013
Note: This plan is invalid unless accompanied by a Go SOLAR permit card and Go SOLAR permit document. Plans must be on job before any inspection will be made.		

GENERAL NOTES:

- DESIGN LOAD CRITERIA
 - FLORIDA BUILDING CODE 2010
 - ASCE 7-10, HURRICANE PRONE REGION
 - BASIC SPEED - 170 mph
 - EXPOSURE CATEGORY : C
 - RISK CATEGORY : II
 - DESIGN LOADS:
 - WIND LOADS
 - +56 PSF POSITIVE PRESSURE
 - 68 PSF UPLIFT
 - DEAD LOAD
 - 20 PSF
- STRUCTURAL BOLTS SHALL CONFORM TO ASTM A304 STAINLESS STEEL
- STAND COMPONENTS TO BE MANUFACTURED BY UNIRAC.
- CONSIDERATION:
 - THESE NOTES SET OUT THE PARAMETERS UNDER WHICH THE SOLAR PANELS MUST BE INSTALLED.
 - BROWARD COUNTY
 - RESIDENTIAL
 - 30' MAXIMUM HEIGHTS IN RESIDENTIAL ROOF
 - THE SLOPE OF THE ROOF MAY BE FROM 7° TO 45° MAX
 - SOLAR PANEL MUST WITHSTAND THE FOLLOWING WIND LOADS:
 - DOWNWARD DIRECTION: +56 PSF
 - UPWARD DIRECTION: -68 PSF
- THIS DESIGN IS BASED ON A ROOF SYSTEM CONSISTING OF PRE-MANUFACTURED TRUSSES @ 24" O.C.
- CONTRACTOR SHALL VERIFY THAT THE EXISTING ROOF STRUCTURAL SYSTEM IS IN GOOD CONDITION AND THAT TRUSSES WERE BUILT WITH STRUCTURAL SOUTHERN PINE OR A DENSER SPECIES; THAT THERE IS NO ROTTEN WOOD OR TERMITE INFESTATION

JUAN E. LAPICA, P.E.
LICENSE NO. 34290
STRUCTURAL ENGINEER

TYLIN INTERNATIONAL
201 ALHAMBRA CIRCLE • SUITE 900
CORAL GABLES, FLORIDA
PHONE: (305) 567-1888 • FAX: (305) 567-1771
E.B.# 00002017
www.tylin.com
04/16/2013

Installing SolarMount

The Unirac Code-Compliant Installation Instructions support applications for building permits for photovoltaic arrays using Unirac PV module mounting systems.

This manual, SolarMount Planning and Assembly, governs installations using the SolarMount and SolarMount HD (Heavy Duty) systems.

[3.1.] SolarMount® rail components


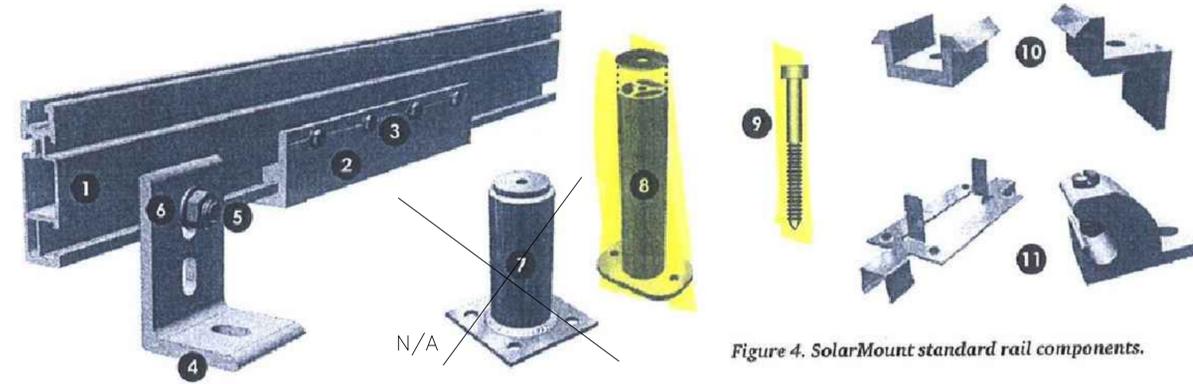


Figure 4. SolarMount standard rail components.


- 1 Rail – Supports PV modules. Use two per row of modules. 6105-T5 aluminum extrusion, anodized.
- 2 Rail splice – Joins and aligns rail sections into single length of rail. It can form either a rigid or thermal expansion joint, 8 inches long, predrilled. 6105-T5 aluminum extrusion, anodized.
- 3 Self-drilling screw – (No. 10 x 3/4") – Use 4 per rigid splice or 2 per expansion joint. Galvanized steel.
- 4 L-foot – Use to secure rails either through roofing material to building structure or standoffs. Refer to loading tables for spacing. Note: Please contact Unirac for use and specification of double L-foot.
- 5 L-foot bolt (3/8" x 3/4") – Use one per L-foot to secure rail to L-foot. 18-8A2 stainless steel.
- 6 Flange nut (3/8") – Use one per L-foot to secure rail to L-foot. 18-8A2 stainless steel.
- 7 N/A
- lock washer for attaching L-foot. Flashings: Use one per standoff. Unirac offers appropriate flashings for both standoff types.
Note: There is also a flange type standoff that does not require an L-foot.
- 8 Aluminum two-piece standoff (optional) (4" and 7") – Use one per L-foot. Two-piece: 6105-T5 aluminum extrusion. Includes 3/8" x 3/4" serrated flange bolt with EPDM washer for attaching L-foot, and two 5/16" lag bolts.
- 9 Lag screw for L-foot (5/16") – Attaches standoff to rafter.
- 10 Top Mounting Clamps
- 11 Top Mounting Grounding Clips and Lugs

Installer supplied materials:

- Lag screw for L-foot – Attaches L-foot or standoff to rafter. Determine the length and diameter based on pull-out values. If lag screw head is exposed to elements, use stainless steel. Under flashings, zinc plated hardware is adequate.
- Waterproof roofing sealant – Use a sealant appropriate to your roofing material. Consult with the company currently providing warranty of roofing.

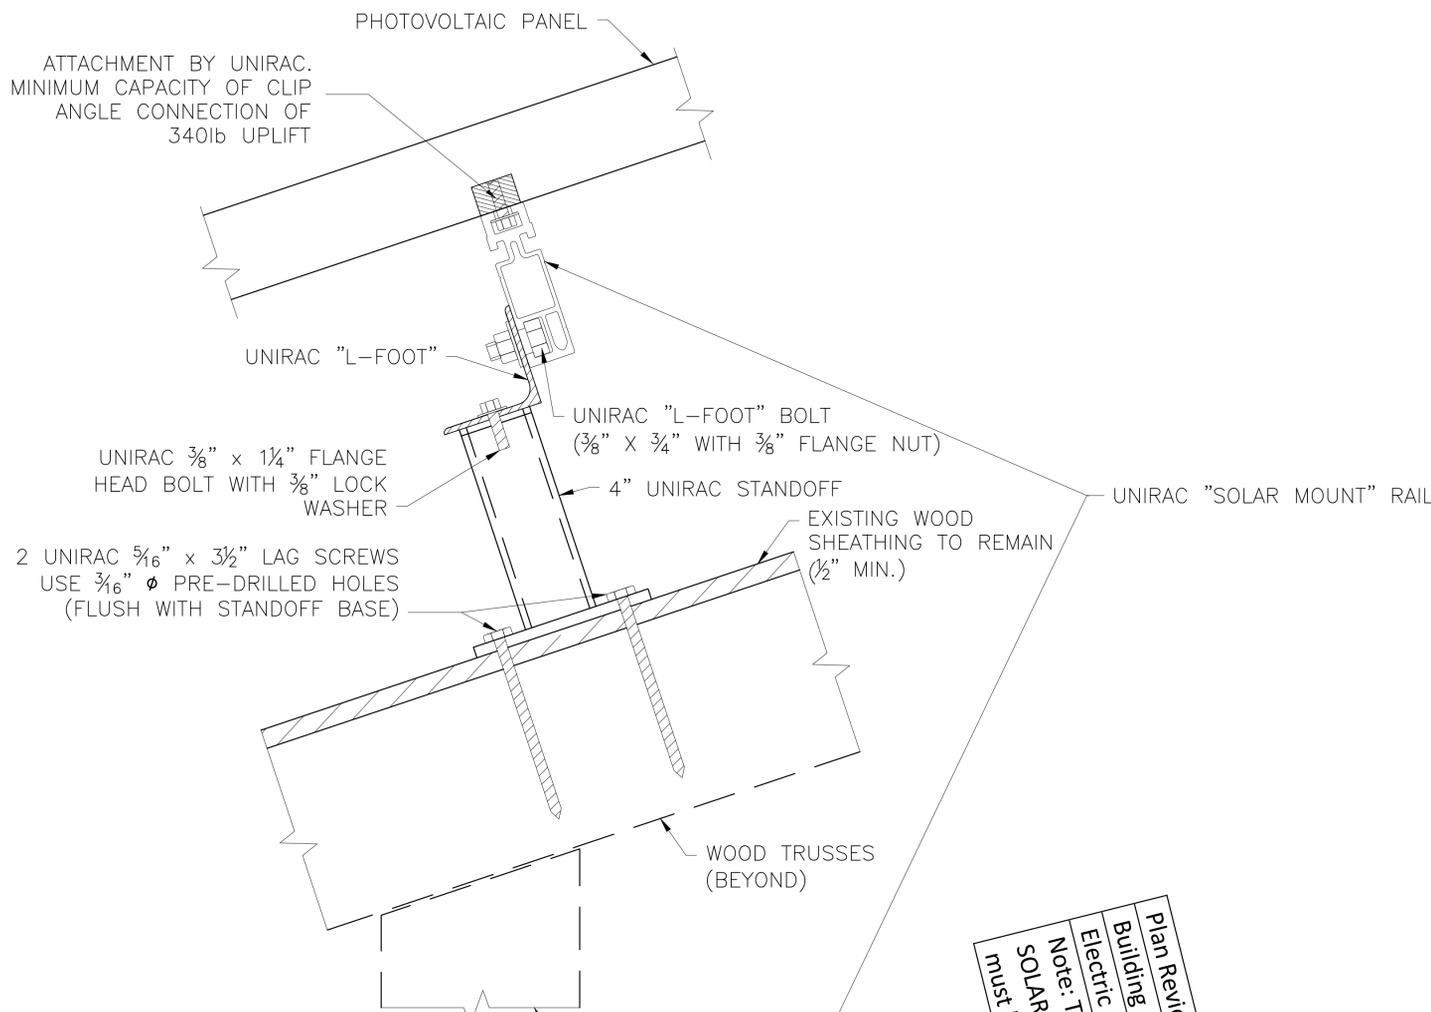

B SECTION B-B
A-2 DETAIL D

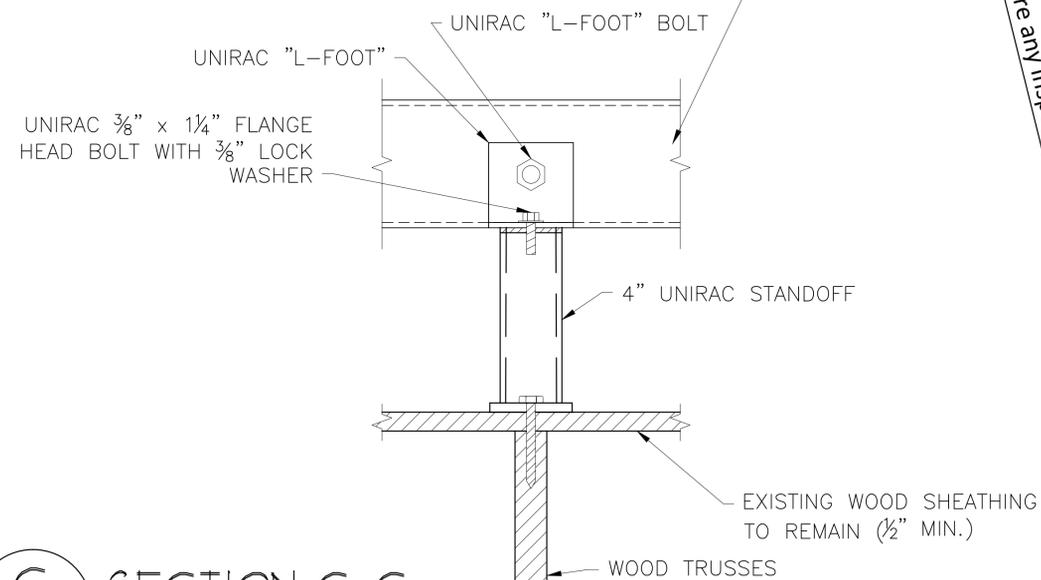

C SECTION C-C
A-2

Plan Review	App. By	Date
Building	J A GOMEZ	05/03/2013
Electric	NA	05/03/2013

Note: This plan is invalid unless accompanied by a Go Solar permit card and Go SOLAR permit document. Plans must be on job before any inspection will be made.

NOTES:

- A. THIS DESIGN IS BASED ON A UNIRAC SUPPORT SYSTEM AND WITHIN THE MIDDLE THIRD OF THE WIDTH OF THE RAFTER
- B. THREAD MUST BE EMBEDDED IN THE SIDE GRAIN OF A RAFTER
- C. INSTALL LAG BOLTS WITH HEAD AND WASHER FLUSH TO SURFACE (NO GAP), DO NOT OVER TIGHTEN
- D. CONTRACTOR TO PRE-DRILL WOOD TRUSS PRIOR TO INSTALLATION OF LAG SCREWS AS INDICATED

JUAN E. LAPICA, P.E.
LICENSE NO. 34290
STRUCTURAL ENGINEER

TYLIN INTERNATIONAL
201 ALHAMBRA CIRCLE • SUITE 900
CORAL GABLES, FLORIDA
PHONE: (305) 567-1888 • FAX: (305) 567-1771
E.B.# 00002017
www.tylin.com
04/16/2013



CARTAYA &
ASSOCIATES
ARCHITECTS P.A.

3077 E. COMMERCIAL BLVD. SUITE 201
FT. LAUDERDALE, FLORIDA 33308
771-2724 FAX 776-4280

AA C001988
BEAU

PROJECT: PHOTOVOLTAIC SYSTEM PROTOTYPE DESIGN
GO SOLAR - BROWARD COUNTY
ENVIRONMENTAL PLANNING AND GROWTH MANAG. DEPT.
ALL DESIGN AND DETAILS INDICATED BY THIS DRAWING ARE FOR USE ON AND IN CONNECTION WITH THE SPECIFIED PROJECT. THIS IS THE PROPERTY OF CARTAYA & ASSOCIATES ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF THE ARCHITECT. THE PRICE OF ANY REPRODUCTION SHALL BE THE DISCRETION OF THE ARCHITECT.

TITLE: 6KW SECTION

DATE: 04-16-2013
DRAWN BY: YR
CHECKED BY: J J

JOB NO: 1236

SHEET: A-3
3 OF 7

WIND LOAD PRESSURE

Using Rooftop Structures and Equipments (29.5.1 Sheet 308) Broward County

Residential: II risk category. (Table 1.5.1/ Sheet 2)

V= 170 Mph

$K_d = 0.85$ (Table 26.6-1/ Sheet 250)

$K_{zt} = 1.0$

$Z = 15' \rightarrow K_z = 0.85$ (Table 29.3-1/ Sheet 310)

$Z = 20' \rightarrow K_z = 0.90$

$Z = 25' \rightarrow K_z = 0.94$

$Z = 30' \rightarrow K_z = 0.98$

$Q = 0.00256 K_z \times K_{zt} \times K_d \times V^2$

$q_{15'} = 53.4 \text{ lb/ft}^2$

$q_{20'} = 56.6 \text{ lb/ft}^2$

$q_{25'} = 59.1 \text{ lb/ft}^2$

$q_{30'} = 61.6 \text{ lb/ft}^2$

Note:

1- We use zone 1 for the calculation of wind load, assuming that the panels may be installed in zone 1.

2- We consider that the panels are not part of the roof and $GC_{pi} = \pm 0$

$\Theta \leq 7^\circ$ (Gable Roof) Fig 30.A-2A/ Sheet 336

$GC_{p123} = +0.3$

$GC_{p1} = -1.0$

$7^\circ < \Theta \leq 27^\circ$ (Gable/ Hip Roof) Fig 30.4-2B/ Sheet 337)

$GC_{p123} = +0.5$

$GC_{p1} = -0.90$

$27^\circ < \Theta \leq 45^\circ$ (Gables Roof) Fig 30.4-2C/ Sheet 338

$GC_{p123} = +0.9$ (This coefficient value is the most critical for the downward load.)

$GC_{p1} = -1.0$

$P = q_h [(GC_p) - (GC_{pi})]$

$27^\circ < \Theta \leq 45^\circ$ $h = 30'$

$p_{123} = 61.6[0.9 - (-0)] = +56 \text{ lb/ft}^2$ (Downward Pressure)

$\Theta \leq 7^\circ$ $h = 30'$

$p_1 = 61.6[-1.1 - (+0)] = -68 \text{ lb/ft}^2$ (Upward Pressure)

$27^\circ < \Theta \leq 45^\circ$ (Monoslope roof) Fig 30.4-5A/ Sheet 341

$GC_{p123} = +0.3$

$GC_{p1} = -1.1$ (This coefficient value is the most critical for the upward load.)

Lag Screw Design

1. Direct Uplift

$A = 2.5' \times 2' = 5 \text{ SF}$ $5 \times 68 = 340 \text{ lb/connection}$

$P = 340 \text{ lb} / 2 \text{ screws}$

$170 \text{ lb} / \text{screw} \Rightarrow 1" \text{ penetration}$

\Rightarrow Use 5/16" \emptyset flat head lag screws

Max. capacity = $0.7 \times 307 = 215 \text{ lb} > 170 \text{ lb}$ OK

$307 \text{ lb} \Rightarrow$ Unirac catalog for "dry" condition

0.7 = Wet use factor

2. Calculations for compliance of 1620.6 FBC

- Shear

$P = 3.1 \times (2+3) / 12 \times 2 \times 53.4 = 138 \text{ lb}$

$\Rightarrow 2 \text{ connections} / 4 \text{ screws}$

$34.5 \text{ lb} / \text{screw}$

- Moment

Southern pine specific gravity 0.55

$2'a = \frac{(\omega' b) z'}{(\omega' b) \cos^2 \alpha + z' \sin \alpha}$ (11.4-1 NDS)

$z' = 140 \text{ lb}$ (NDS Table 11K)

$\omega = 307 \text{ lb/in} - 5/16" \emptyset$ (NDS Table 11.2A)

$M = 138 \times 8" = 1080 \text{ in. lb}$ $1080 / 2 = 540 \text{ in. lb} / \text{connection}$

$T/C = 540 / 2.75 = 196 \text{ lb}$

Total withdrawal = $196 + 170 = 366 \text{ lb}$

Total shear = 34.5 lb $\alpha = 85^\circ$

$2'a = \frac{(307 \times 3) 140}{(307 \times 3) 0.09 + 180 \times 1} = 578 \text{ lb}$

$578 \times 0.7 = 404 > 366 \text{ lb}$

Note: This plan is invalid unless accompanied by a Go SOLAR permit card and Go SOLAR permit document. Plans must be on job before any inspection will be made.

Plan Review	App. By	Date
Building	J A GOMEZ	05/03/2013
Electric	NA	05/03/2013

JUAN E. LAPICA, P.E.
 LICENSE NO. 34290
 STRUCTURAL ENGINEER

TYLIN INTERNATIONAL
 201 ALHAMBRA CIRCLE • SUITE 900
 CORAL GABLES, FLORIDA
 PHONE: (305) 567-1888 • FAX: (305) 567-1771
 E.B.# 00002017
 www.tylin.com
 04/16/2013



CARTAYA & ASSOCIATES ARCHITECTS P.A.

3077 E. COMMERCIAL BLVD. SUITE 201
 FT. LAUDERDALE, FLORIDA 33308
 771-2724 FAX 776-4280

BEAU AA C001988

PROJECT: PHOTOVOLTAIC SYSTEM PROTOTYPE DESIGN
 GO SOLAR - BROWARD COUNTY
 ENVIRONMENTAL PLANNING AND GROWTH MANAG. DEPT.
ALL DIMENSIONS AND DETAILS UNLESS INDICATED BY THIS DRAWING ARE FOR FIELD USE ONLY AND BE CONSIDERED AS APPROXIMATE. THE USER SHALL BE RESPONSIBLE FOR VERIFYING THE ACCURACY OF ALL DIMENSIONS AND DETAILS. THIS IS THE PROPERTY OF CARTAYA & ASSOCIATES ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION OF CARTAYA & ASSOCIATES ARCHITECTS, P.A. AND NOT BE USED FOR ANY OTHER PROJECTS WITHOUT THE WRITTEN PERMISSION OF CARTAYA & ASSOCIATES ARCHITECTS, P.A.

TITLE: 6KW CALCS

JOB NO: 1236

DATE: 04-16-2013

DRAWN BY: YR

CHECKED BY: JJ

SHEET: A-4

4 OF 7

Part II. Procedure to Select Rail Span and Rail Type

[2.1.] Using Standard Beam Calculations, Structural Engineering Methodology

The procedure to determine the Unirac SolarMount series rail type and rail span uses standard beam calculations and structural engineering methodology. The beam calculations are based on a simply supported beam conservatively, ignoring the reductions allowed for supports of continuous beams over multiple supports. Please refer to Part I for more information on beam calculations, equations and assumptions. If beams are installed perpendicular to the eaves on a roof steeper than a 4/12 pitch in an area with a ground snow load greater than 30psf, then additional analysis is required for side loading on the roof attachment and beam.


In using this document, obtaining correct results is dependent upon the following:

1. Obtain the *Snow Load* for your area from your local building official.
2. Obtain the *Design Wind Load, P_{net}*. See Part I (Procedure to Determine the Design Wind Load) for more information on calculating the *Design Wind Load*.
3. **Please Note:** The terms rail span and footing spacing are interchangeable in this document. See Figure 3 for illustrations.
4. To use Table 8 and Table 9 the *Dead Load* for your specific installation must be less than 5 psf, including modules and Unirac racking systems. If the *Dead Load* is greater than 5 psf, see your Unirac distributor, a local structural engineer or contact Unirac.

The following procedure will guide you in selecting a Unirac rail for a flush mount installation. It will also help determine the design loading imposed by the Unirac PV Mounting Assembly that the building structure must be capable of supporting.

Step 1: Determine the Total Design Load

Figure 3. Rail span and footing spacing are interchangeable.

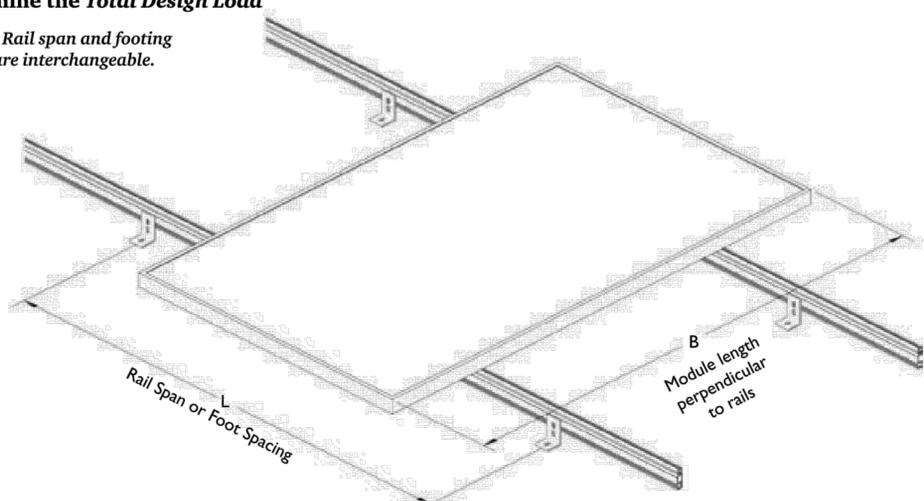

The *Total Design Load, P (psf)* is determined using ASCE 7-10 2.4.1 (ASD Method equations 3,5,6 and 7) by adding the *Snow Load¹, S (psf)*, *Design Wind Load, P_{net} (psf)* from Part I, Step 9 and the *Dead Load (psf)*. Both Uplift and Downforce Wind Loads calculated in Step 9 of Part I must be investigated. Use Table 7 to calculate the Total Design Load for the load cases. Use the maximum absolute value of the three downforce cases and the uplift case for sizing the rail. Use the uplift case only for sizing lag bolts pull out capacities (Part II, Step 6). Use the following equations or Table 7.

$$P (psf) = 1.0D + 1.0S^1$$

N/A

$$P (psf) = 1.0D + 1.0P_{net}$$

20+56=76 psf

$$P (psf) = 1.0D + 0.75S^1 + 0.75P_{net}$$

20+(0.75 x 56)=62 psf

$$P (psf) = 0.6D + 1.0P_{net}$$

0.6 x 20+68=56 psf

$$D = \text{Dead Load (psf)}$$

20 psf

$$S = \text{Snow Load (psf)}$$

N/A

$$P_{net} = \text{Design Wind Load (psf) (Positive for downforce, negative for uplift)}$$

The maximum Dead Load, D (psf), is 5 psf based on market research and internal data.

¹ Snow Load Reduction - The snow load can be reduced according to Chapter 7 of ASCE 7-05. The reduction is a function of the roof slope, Exposure Factor, Importance Factor and Thermal Factor. Please refer to Chapter 7 of ASCE 7-05 for more information.

Plan Review
 Building: J A GOMEZ
 Electric: NA
 App. By: J A GOMEZ
 Date: 05/03/2013
 Note: This plan is invalid unless accompanied by a Go SOLAR permit card and Go SOLAR permit document. Plans must be on job before any inspection will be made.

Note: Modules must be centered symmetrically on the rails (+/- 2*), as shown in Figure 3.

Table 7. ASCE 7 ASD Load Combinations

Description	Variable	Downforce Case 1	Downforce Case 2	Downforce Case 3	Uplift	units
Dead Load	D	1.0 x	1.0 x	1.0 x	0.6 x	psf
Snow Load	S	1.0 x + _____		0.75 x + _____		psf
Design Wind Load	P _{net}		1.0 x + _____	0.75 x + _____	1.0 x -	psf
Total Design Load	P	N/A	76	62	-56	psf

Note: Table to be filled out or attached for evaluation.

Step 2: Determine the Distributed Load on the rail, w (plf)

Determine the *Distributed Load, w (plf)*, by multiplying the module length, B (ft), by the *Total Design Load, P (psf)* and dividing by two. Use the maximum absolute value of the three downforce cases and the Uplift Case. We assume each module is supported by two rails.

$$w = PB/2$$

w = Distributed Load (pounds per linear foot, plf)

B = Module Length Perpendicular to Rails (ft)

P = Total Design Pressure (pounds per square foot, psf)

Step 3: Determine Rail Span/ L-Foot Spacing

Using the *distributed load, w*, from Part II, Step 2, look up the *allowable spans, L*, for each Unirac rail type, SolarMount (SM) and SolarMount Heavy Duty (HD).

The L-Foot SolarMount Series Rail Span Table uses a single L-foot connection to the roof, wall or stand-off. Please refer to the Part III for more installation information.

$$\text{CASE 2} = 76 \times 2.5/2 = 95 \text{ pounds}$$

$$\text{UPLIFT} = -56 \times 2.5/2 = 70 \text{ pounds}$$


therefore USE UNIRACK SolarMount

Table 8. L-Foot SolarMount Series Rail Span

Span (ft)	Distributed Load (pounds/linear foot)															
	20	25	30	40	50	60	80	100	120	140	160	180	200	220	240	260
2	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM
2.5	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD
3	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD	HD
3.5	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD	HD	
4	SM	SM	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD	HD		
4.5	SM	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD	HD			
5	SM	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD				
5.5	SM	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD				
6	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD	HD					
6.5	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
7	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
7.5	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
8	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
8.5	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
9	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
9.5	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
10	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
10.5	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
11	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
11.5	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						
12	SM	SM	SM	SM	SM	SM	SM	SM	HD	HD						

JUAN E. LAPICA, P.E.
 LICENSE NO. 34290
 STRUCTURAL ENGINEER

TYLIN INTERNATIONAL
 201 ALHAMBRA CIRCLE • SUITE 900
 CORAL GABLES, FLORIDA
 PHONE: (305) 567-1888 • FAX: (305) 567-1771
 E.B.# 00002017
 www.tylin.com
 04/16/2013



CARTAYA & ASSOCIATES ARCHITECTS P.A.

3077 E. COMMERCIAL BLVD. SUITE 201
 FT. LAUDERDALE, FLORIDA 33308
 771-2724 FAX 776-4280

BEAU
 AA C001888

PROJECT: PHOTOVOLTAIC SYSTEM PROTOTYPE DESIGN
 GO SOLAR - BROWARD COUNTY
 ENVIRONMENTAL PLANNING AND GROWTH MANAG. DEPT.
ALL DESIGN AND DETAILS SUBJECT TO REVISIONS BY THE CLIENT OR AS A RESULT OF CONSULTATION WITH THE SPECIFIED PROJECT TEAM. THIS IS THE PROPERTY OF CARTAYA & ASSOCIATES ARCHITECTS P.A. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, WITHOUT WRITTEN PERMISSION FROM CARTAYA & ASSOCIATES ARCHITECTS P.A. ANY UNAUTHORIZED REPRODUCTION OR TRANSMISSION OF THIS DOCUMENT IS STRICTLY PROHIBITED AND WILL BE PROSECUTED TO THE FULL EXTENT OF THE LAW.

TITLE: 6KW CALCS

DATE: 04-16-2013
 DRAWN BY: YR
 CHECKED BY: J J

JOB NO: 1236

SHEET: A-5
 5 OF 7

Table 10. Downforce Point Load Calculation

Total Design Load (downforce) (max of case 1, 2 or 3)	P		95	psf	Step 1
Module length perpendicular to rails	B	x	2	ft	Step 4
Rail Span	L	x	2.5	ft	
			475	/2	
Downforce Point Load	R		238	lbs	OK

Step 6: Determine the Uplift Point Load, R (lbs), at each connection based on rail span

You must also consider the Uplift Point Load, R (lbs), to determine the required lag bolt attachment to the roof (building) structure.

Table 11. Uplift Point Load Calculation


Total Design Load (uplift)	P		-70	psf	Step 1
Module length perpendicular to rails	B	x	2	ft	Step 4
Rail Span	L	x	2.5	ft	
			350	/2	
Uplift Point Load	R		175	lbs	

Table 12. Lag pull-out (withdrawal) capacities (lbs) in typical roof lumber (ASD)

	Specific gravity	Lag screw specifications	
		1/2" shaft,*	per inch thread depth
Douglas Fir, Larch	0.50	266	
Douglas Fir, South	0.46	235	
Engelmann Spruce, Lodgepole Pine (MSR 1650 f & higher)	0.46	235	
Hem, Fir, Redwood (close grain)	0.43	212	
Hem, Fir (North)	0.46	235	
Southern Pine	0.55	307	
Spruce, Pine, Fir	0.42	205	
Spruce, Pine, Fir (E of 2 million psi and higher grades of MSR and MEL)	0.50	266	

Use Table 12 to select a lag bolt size and embedment depth to satisfy your Uplift Point Load Force, R (lbs), requirements.

It is the installer's responsibility to verify that the substructure and attachment method is strong enough to support the maximum point loads calculated according to Step 5 and Step 6.

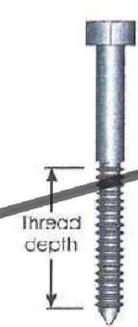

Sources: American Wood Council, NDS 2005, Table 11.2A, 11.3.2A.

- (1) Thread must be embedded in the side grain of a rafter or other structural member integral with the building structure.
- (2) Lag bolts must be located in the middle third of the structural member.
- (3) These values are not valid for wet service.
- (4) This table does not include shear capacities. If necessary, contact a local engineer to specify lag bolt size with regard to shear forces.
- (5) Install lag bolts with head and washer flush to surface (no gap). Do not over-torque.
- (6) Withdrawal design values for lag screw connections shall be multiplied by applicable adjustment factors if necessary. See Table 10.3.1 in the American Wood Council NDS for Wood Construction.

*Use flat washers with lag screws.

Step 4: Select Rail Type

Selecting a span and rail type affects the price of your installation. Longer spans produce fewer wall or roof penetrations. However, longer spans create higher point load forces on the building structure. A point load force is the amount of force transferred to the building structure at each connection.

It is the installer's responsibility to verify that the building structure is strong enough to support the point load forces.

Step 5: Determine the Downforce Point Load, R (lbs), at each connection based on rail span

When designing the Unirac Flush Mount Installation, you must consider the downforce Point Load, R (lbs) on the roof structure.

The Downforce, Point Load, R (lbs), is determined by multiplying the Total Design Load, P (psf) (Step 1) by the Rail Span, L (ft) (Step 3) and the Module Length Perpendicular to the Rails, B (ft) divided by two.

$$R \text{ (lbs)} = PLB/2$$

R = Point Load (lbs)


P = Total Design Load (psf)

L = Rail Span (ft)

B = Module Length Perpendicular to Rails (ft)

It is the installer's responsibility to verify that the building structure is strong enough to support the maximum point loads calculated according to Step 5.

Plan Review Building Electric App. By J A GOMEZ Date 05/03/2013
 Note: This plan is invalid unless accompanied by a Go SOLAR permit card and Go SOLAR permit document. Plans must be on job before any inspection will be made.



CARTAYA & ASSOCIATES ARCHITECTS P.A.

3077 E. COMMERCIAL BLVD. SUITE 201 FT. LAUDERDALE, FLORIDA 33308 771-2724 FAX 776-4280


AA 000988

PHOTOVOLTAIC SYSTEM PROTOTYPE DESIGN
 GO SOLAR - BROWARD COUNTY
 ENVIRONMENTAL PLANNING AND GROWTH MANAG. DEPT.
 ALL DESIGN AND DETAILS ASSOCIATE OF ARCHITECTS, P.A. AND SHALL NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION FROM ARCHITECTS, P.A. AND NOT BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM, WITHOUT THE WRITTEN PERMISSION FROM ARCHITECTS, P.A.


TITLE: 6KW CALCS
 SHEET: A-6
 JOB NO: 1236
 DATE: 04-16-2013
 DRAWN BY: YR
 CHECKED BY: J J
 6 OF 7

JUAN E. LAPICA, P.E.
 LICENSE NO. 34290
 STRUCTURAL ENGINEER


TYLIN INTERNATIONAL
 201 ALHAMBRA CIRCLE • SUITE 900
 CORAL GABLES, FLORIDA
 PHONE: (305) 567-1888 • FAX: (305) 567-1771
 E.B.# 00002017
 www.tylin.com
 04/16/2013

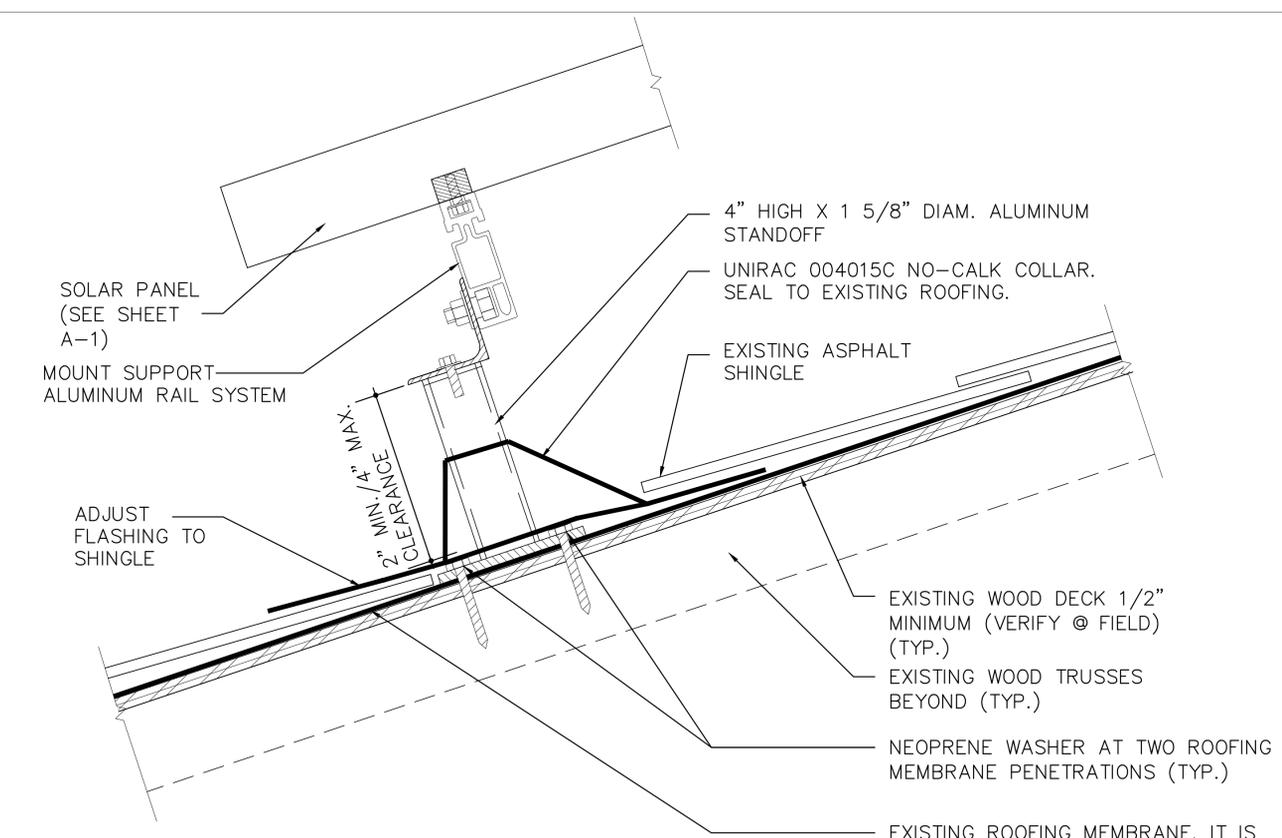


1 ASPHALT SHINGLE ROOFING WATERPROOFING DETAIL

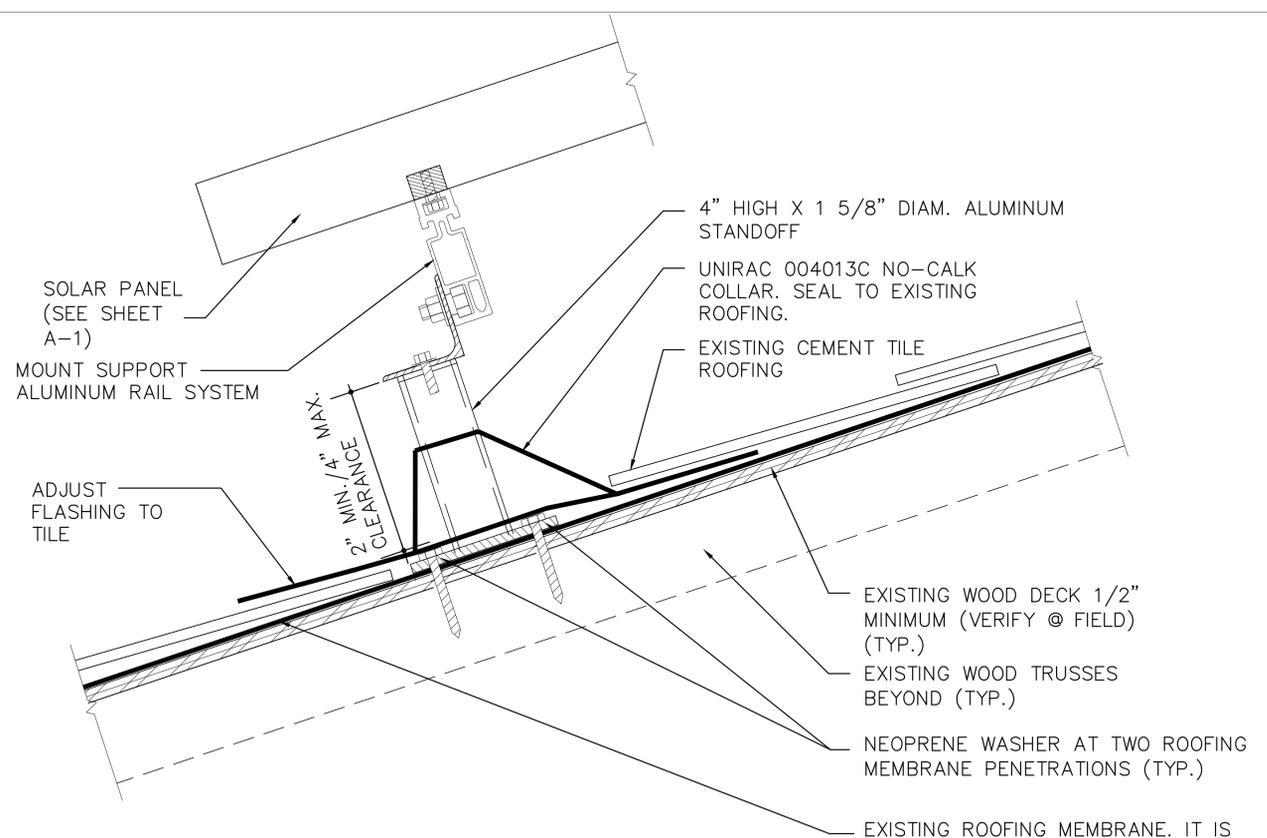

2 CEMENT TILE ROOFING WATERPROOFING DETAIL

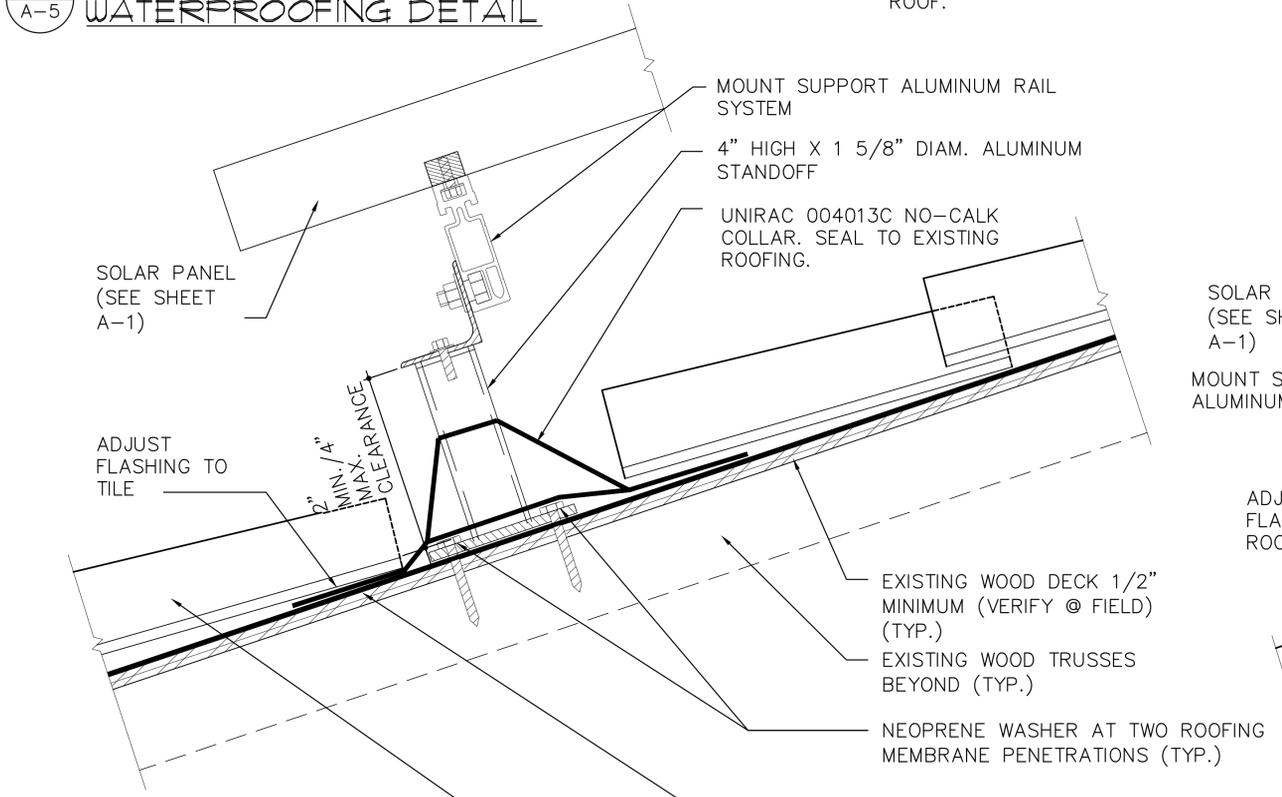

3 SPANISH "S" CERAMIC ROOFING WATERPROOFING DETAIL

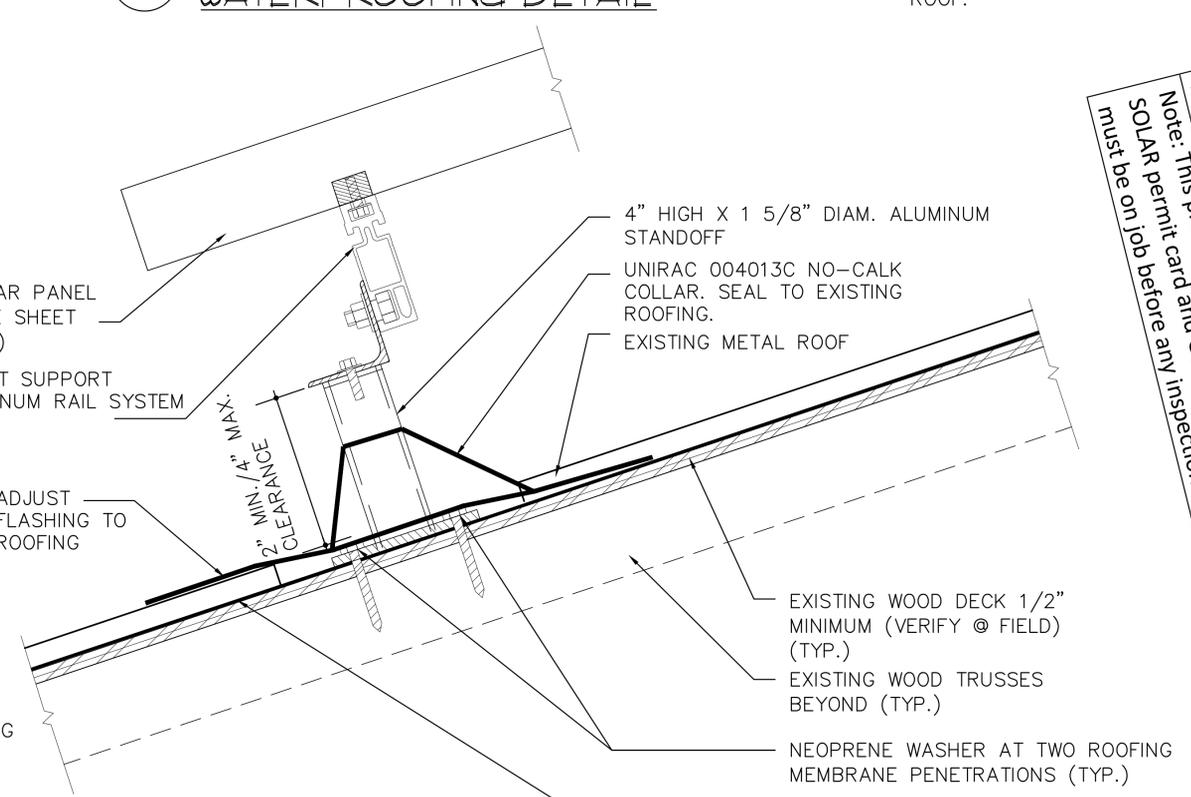

4 METAL ROOFING WATERPROOFING DETAIL

Plan Review	App. By	Date
Building	J A GOMEZ	05/03/2013
Electric	NA	05/03/2013
Note: This plan is invalid unless accompanied by a Go Solar permit card and Go Solar permit will be made.		
must be on job before any inspection will be made.		

JUAN E. LAPICA, P.E.
LICENSE NO. 34290
STRUCTURAL ENGINEER

TYLIN INTERNATIONAL
201 ALHAMBRA CIRCLE • SUITE 900
CORAL GABLES, FLORIDA
PHONE: (305) 567-1888 • FAX: (305) 567-1771
E.B.# 00002017
www.tylin.com
04/16/2013